


ECN #	REV	REV RECORD	DATE	BY	APP
102596	"A"	CHANGED CABLE FROM ARMORED	10/25/96	RD	RD
123096	"B"	CHGD WIRE WAS BELDEN 88442	12/30/96	RD	RD
021397	"C"	CHGD LEAD WIRE TYPE	02/13/97	RD	RD
31497	"D"	CHGD FRM ALPHA 55102	3/14/97	TW	TW
121597	"E"	ADDED NOTE 1	12/15/97	TW	RD
121797	"F"	CHGD HOUSING SHIELD NOTE	12/17/97	OD	RD
123097	G	CHGD HOUSING REV	12/30/97	RD	RD

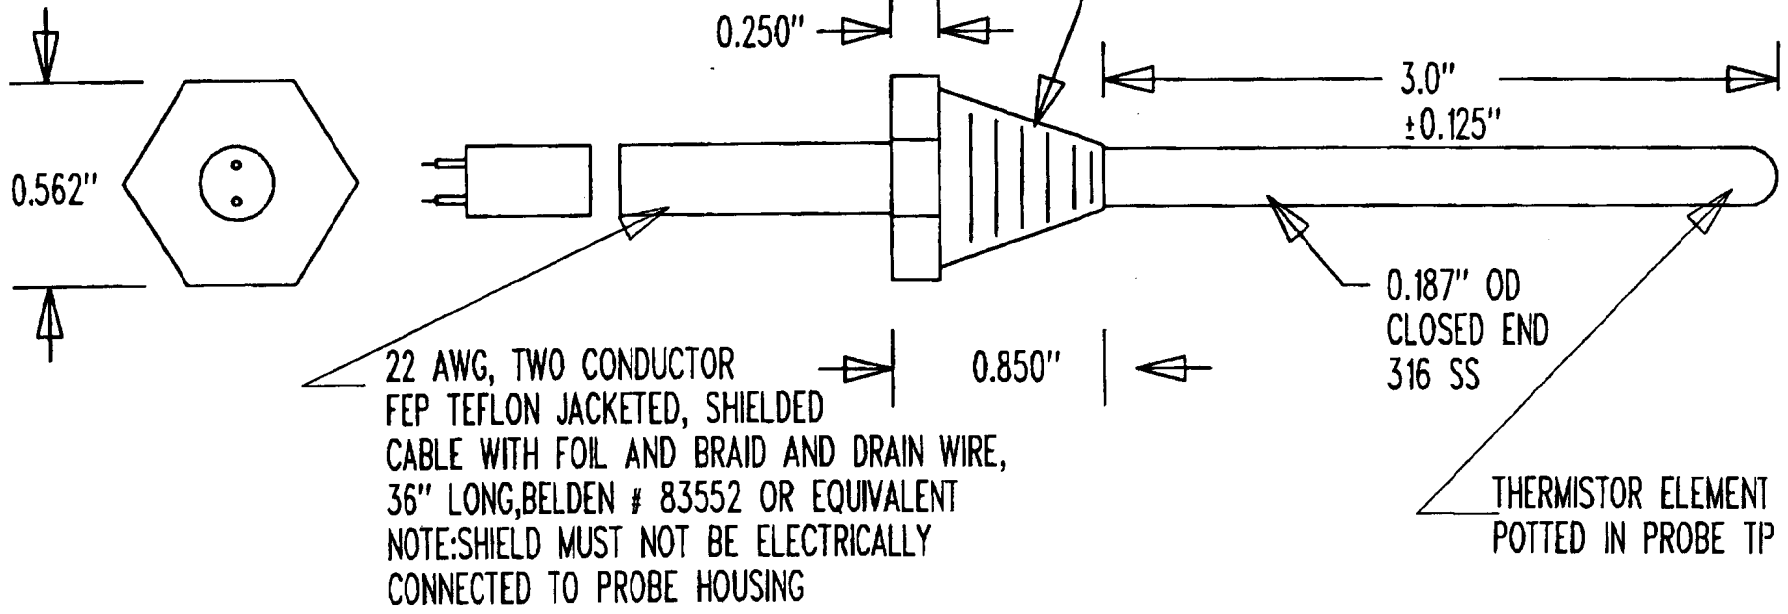

RESISTANCE @ 25 DEG C = 10,000 Ω NOM
 ACCURACY (-40 TO +70°C) = ±0.2°C
 RESISTANCE/TEMPERATURE CURVE = COMP "J"
 OPERATING TEMPERATURE RANGE = -55 TO +100°C

NOTE 1 = USE HOUSING P/N MC10019 REV F

SCALE	NONE	U.S. SENSOR CORP. 1832 W. COLLINS AVE. ORANGE, CA. 92867
DRAWN BY	R. DANKERT	
DATE	7/26/96	THERMISTOR PROBE ASSY
REV.	"G"	P/N USP2119